

Photometric Test Report

IES INDOOR REPORT
PHOTOMETRIC FILENAME : L052411805.IES
DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
 [TEST] L052411805
 [TESTLAB] LIGHT LABORATORY, INC. (www.lightlaboratory.com)
 [ISSUE DATE] 6/10/2024
 [MANUFAC] Bartco Lighting, Inc.
 [LUMCAT] BSW255-4-35-RN-1-R-NA-1-NA-C4-SN-AW
 [LUMINAIRE] Fathom 2" W Direct/Indirect Luminaire for Outdoor Locations,
 [MORE] 48-5/8" Nom. O.A., 3500K, 120-277V Non-Dimming Driver,
 [MORE] Reg. Output Indirect, N/A Output Direct, Lambertian Indirect, N/A Direct,
 [MORE] 4' Cable Mount, Single Config., Architectural White Finish
 [BALLASTCAT] AMPEROR ANP101-24P1-277-2500L-1-P
 [OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND
 [MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.
 [INPUT] 120VAC
 [TEST PROCEDURE] IESNA:LM-79-19

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2706
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	122
Total Luminaire Watts	22.25
Ballast Factor	1.00
CIE Type	Indirect
Spacing Criterion (0-180)	N.A.
Spacing Criterion (90-270)	N.A.
Spacing Criterion (Diagonal)	N.A.
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.83 ft
Luminous Width (90-270)	0.17 ft
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	0	0	0
55	0	0	0
65	0	0	0
75	0	0	0
85	0	0	0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : L052411805.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	0.00	N.A.	0.00
0-30	0.00	N.A.	0.00
0-40	0.00	N.A.	0.00
0-60	0.00	N.A.	0.00
0-80	0.00	N.A.	0.00
0-90	0.00	N.A.	0.00
10-90	0.00	N.A.	0.00
20-40	0.00	N.A.	0.00
20-50	0.00	N.A.	0.00
40-70	0.00	N.A.	0.00
60-80	0.00	N.A.	0.00
70-80	0.00	N.A.	0.00
80-90	0.00	N.A.	0.00
90-110	166.36	N.A.	6.10
90-120	436.82	N.A.	16.10
90-130	840.91	N.A.	31.10
90-150	1854.27	N.A.	68.50
90-180	2706.29	N.A.	100.00
110-180	2539.93	N.A.	93.90
0-180	2706.29	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	0.00
10-20	0.00
20-30	0.00
30-40	0.00
40-50	0.00
50-60	0.00
60-70	0.00
70-80	0.00
80-90	0.00
90-100	32.01
100-110	134.35
110-120	270.46
120-130	404.09
130-140	497.52
140-150	515.84
150-160	445.70
160-170	300.33
170-180	105.99


IES INDOOR REPORT
PHOTOMETRIC FILENAME : L052411805.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10	0
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8	0
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7	0
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6	0
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5	0
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4	0
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4	0
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3	0
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3	0
9	43	32	25	20	37	28	22	18	19	15	13	11	9	8	4	3	3	0
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2	0

POLAR GRAPH

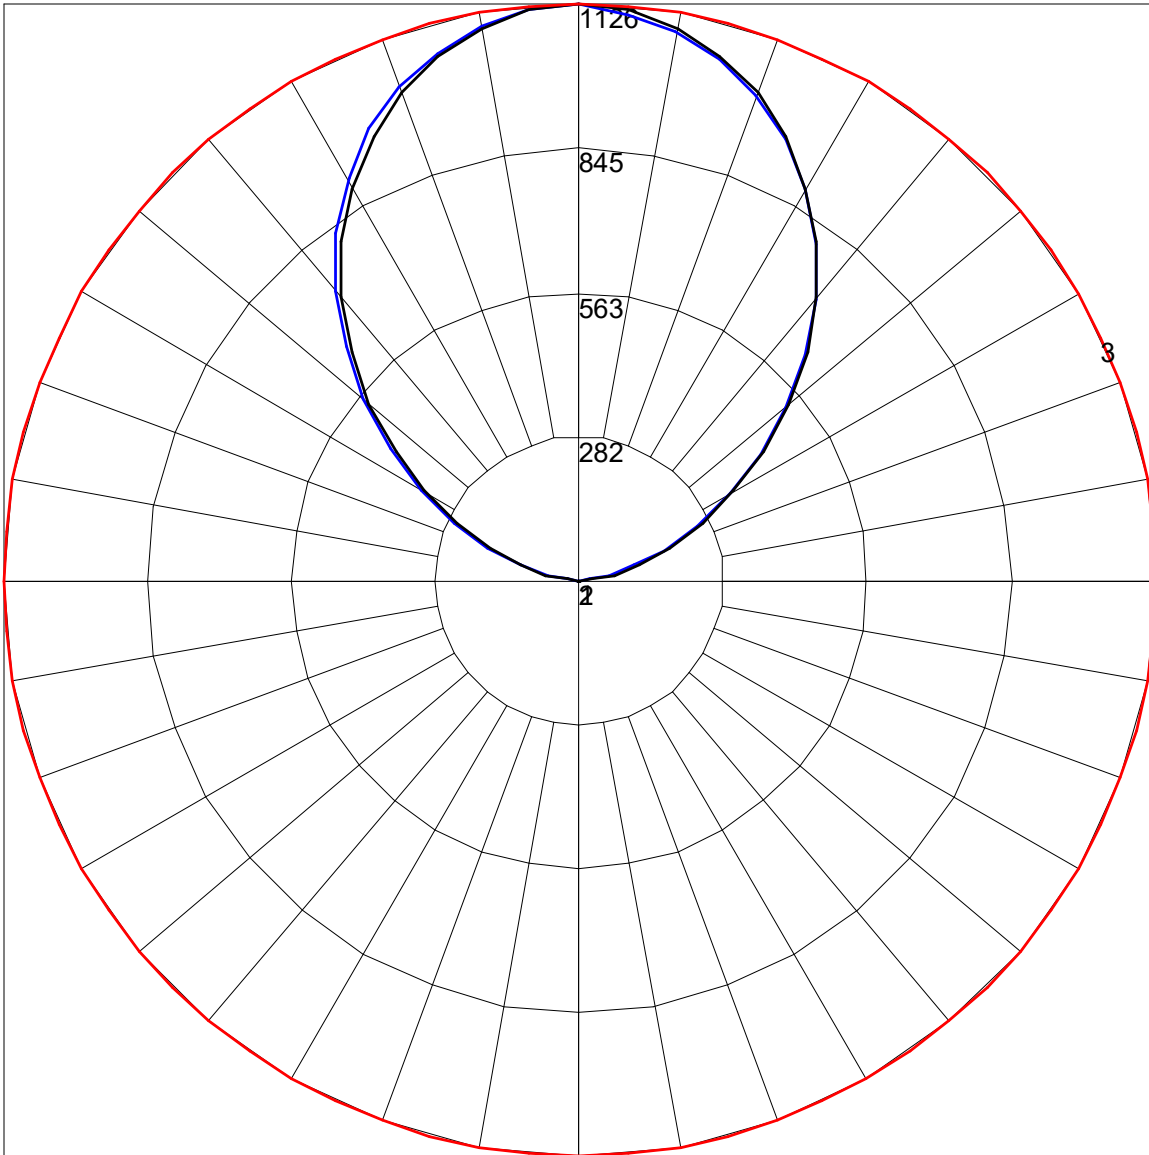

Maximum Candela = 1126 Located At Horizontal Angle = 0, Vertical Angle = 180
1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)
2 - Vertical Plane Through Horizontal Angles (90 - 270)
3 - Horizontal Cone Through Vertical Angle (180) (Through Max. Cd.)